


Wahaha(Hangzhou)

❖ Bottle Water for Drinking

❖ Juice & Tea Use

❖ Lay out of Equipment

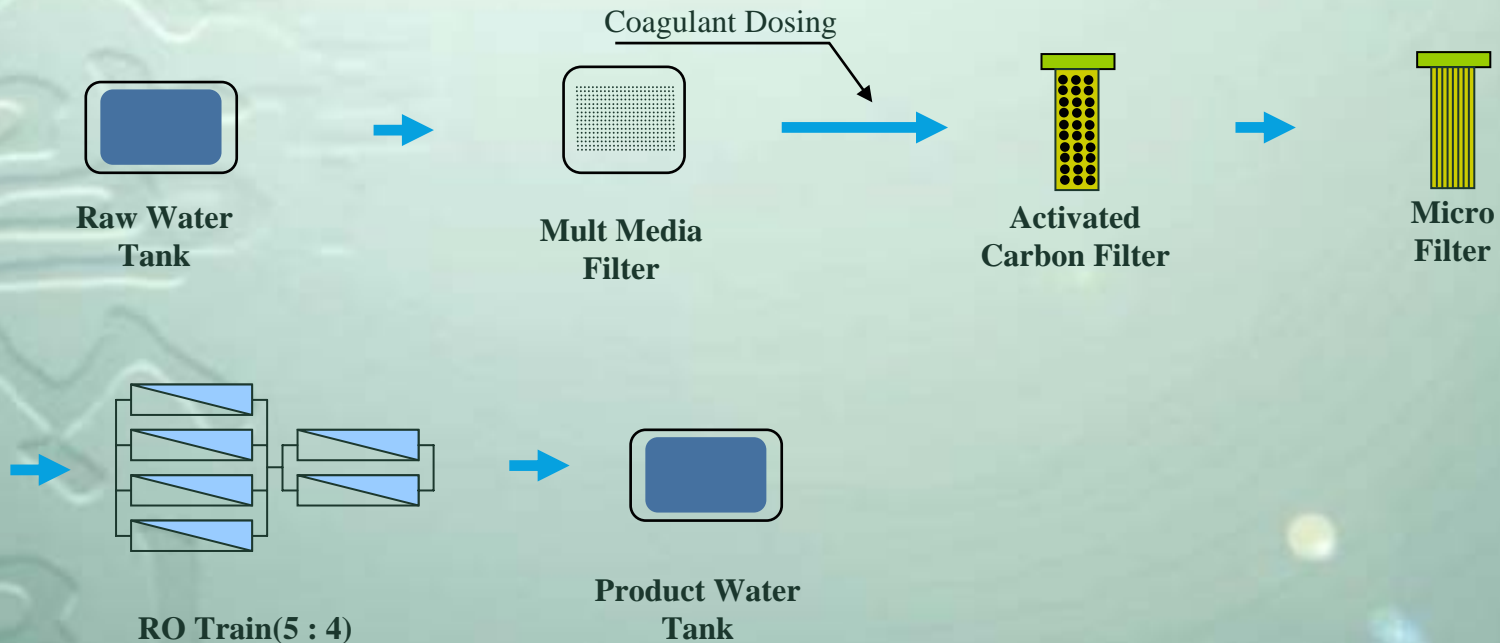

Details of CSM Installation

Operating Duration

❖ '03. 5

CSM Model

❖ RE8040-BE / 54pcs
(54pcs x 1train)

Capacity of Equip.

❖ 54m³/hr

RO Array

❖ 5 : 4 (6elements / vessel)

Average Permeate Flux : 15.9 gfd

Feed Water


- ❖ Surface Water(鐵塘江)
- ❖ Conductivity increase in summer season by sea water intrusion(200 ~ 250 μ s/cm)

Permeate Quality

- ❖ 1st RO 40 μ s/cm(Juice & Tea Use)
- ❖ 2nd RO 10 μ s/cm(Bottled Water Use)


Normalized Operating Data

❖ Normalized Permeate Flow

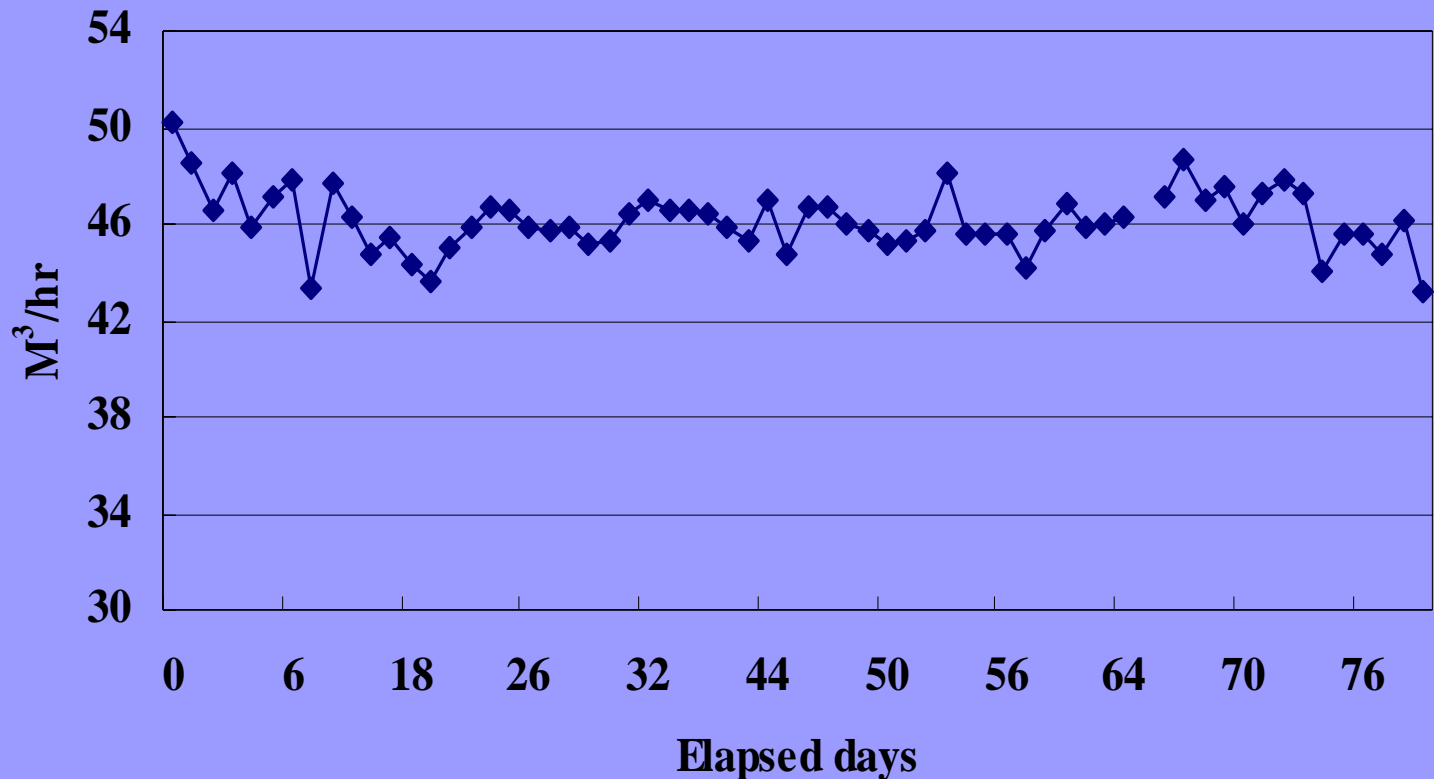


Normalized Operating Data

❖ Normalized Salt Rejection

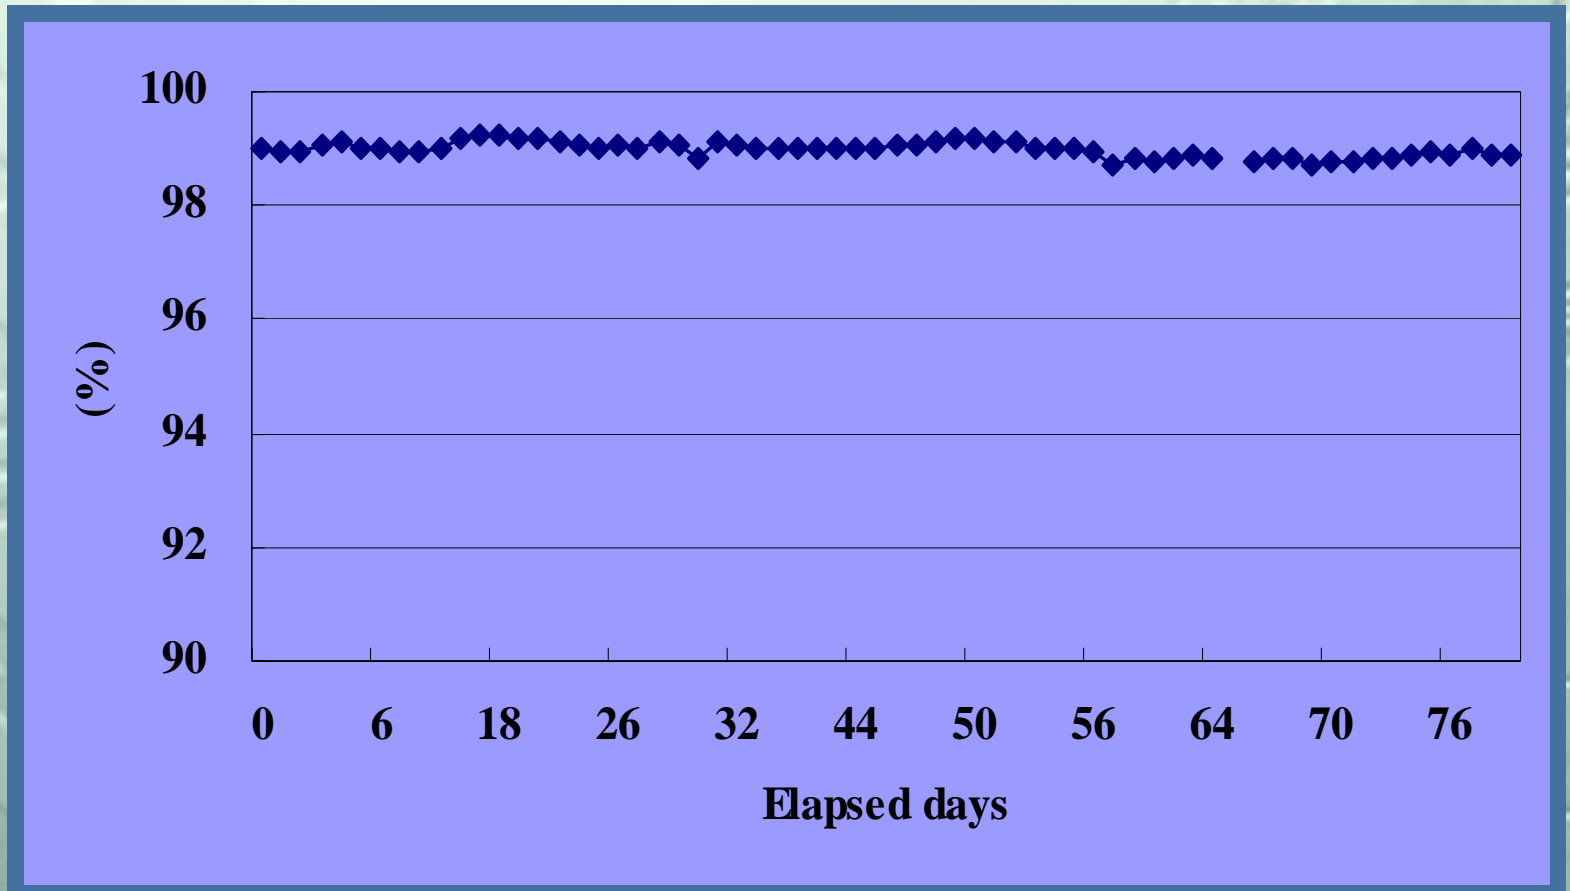

Normalized Operating Data

❖ Differential Pressure

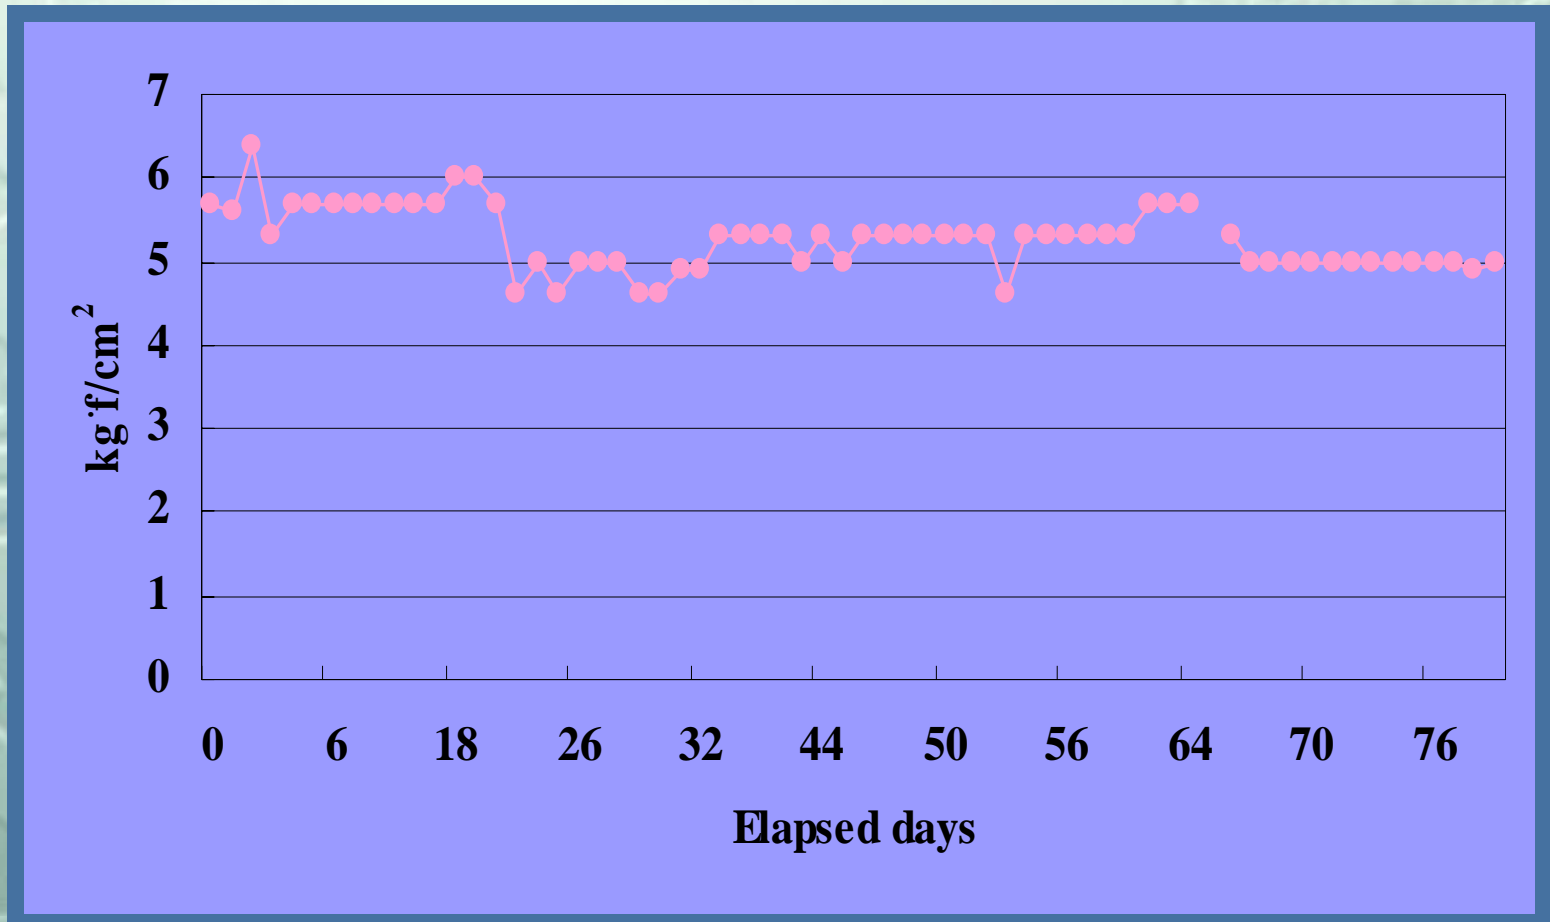

Related Photos

