

On-Going Pilot Test

- ❖ Site : Point Loma Wastewater Treatment Plant, San Diego



On-Going Pilot Test

❖ Feed Water : Tertiary Treated Wastewater


❖ Supervisor : Montgomery Watson Harza

❖ Details of CSM Installation

- Applied Model CSM RE4040-FE(85ft²) / 6pcs
- Array 1 : 1(3elements/vessel)
- Recovery 50%
- Average Permeate Flux 10gfd(Target)
- Operating Start April, 04, 2003

On-Going Pilot Test

❖ Normalized Salt Rejection & Permeate Flow

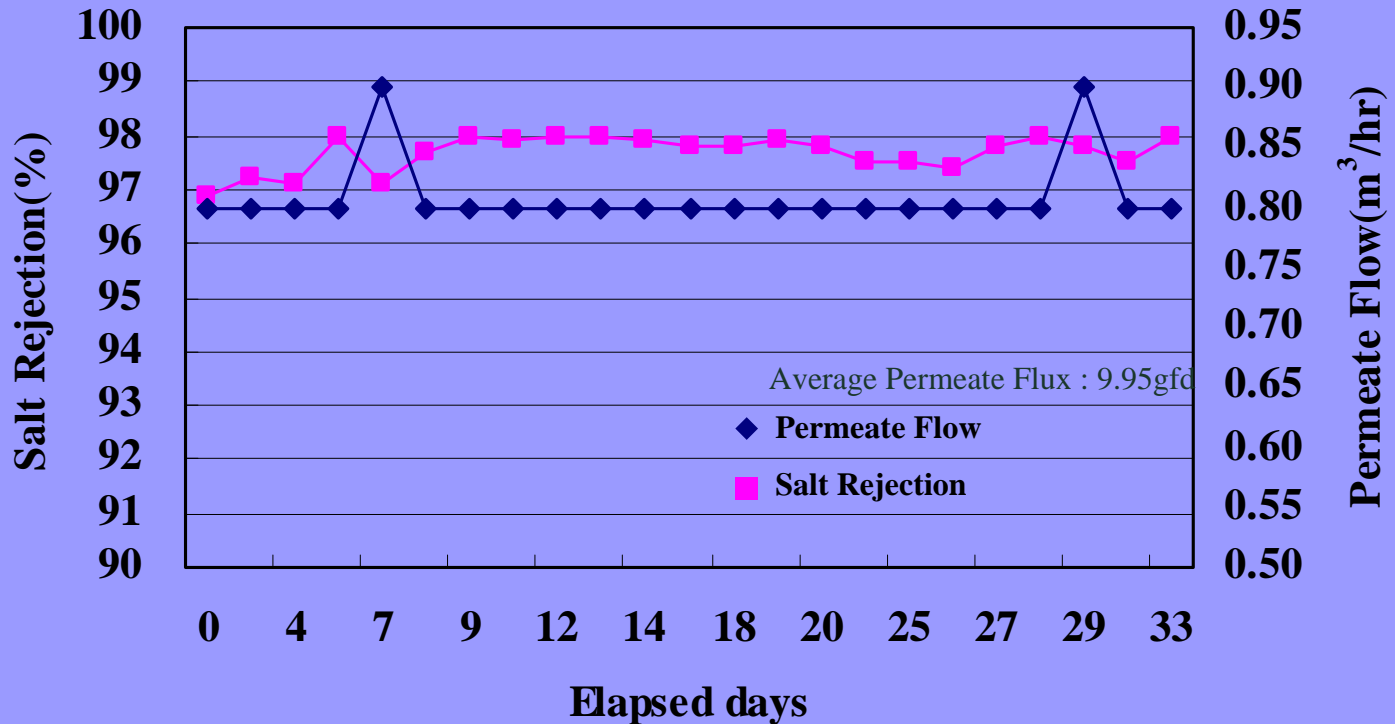

On-Going Pilot Test

❖ Related Photos



On-Going Pilot Test

❖ Related Photos

